



ELEVATION

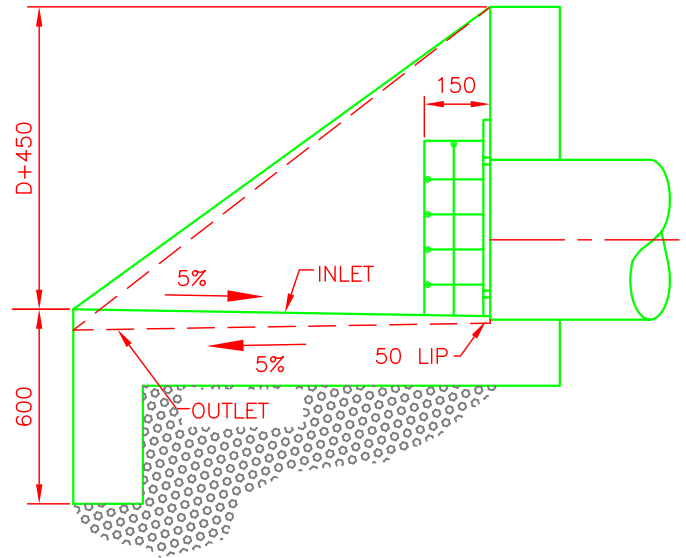

SECTION A-A

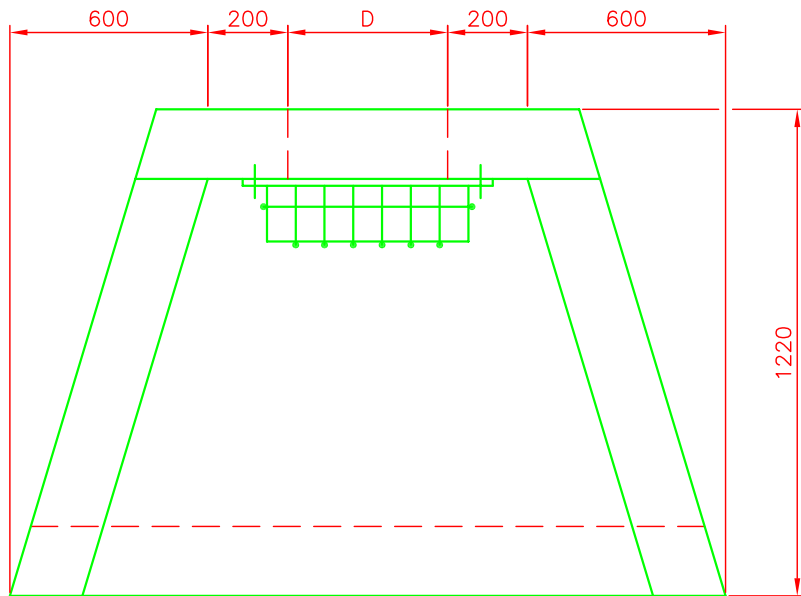

PLAN

NOTES:

1. ALL WALLS & SLABS 200mm
2. CONCRETE MIN. 25 MPa.
3. BASE SHALL BE 150mm COMPACTED PIT RUN
4. REINFORCING WALL SHALL BE 15M @300 EACH WAY. EACH WALL & SLAB. MIN. BOND LENGTH ON CORNER BARS 460mm
5. PLACE CONCRETE RIP RAP 300mm THICK FOR 5m FROM INLET & OUTLET STRUCTURE

UNITS ARE IN MILLIMETERS
UNLESS OTHERWISE NOTED

**CONCRETE OUTLET
AND
INLET STRUCTURE**

2	City	Drawings revised	02/99
1	Usi	Original drawings created	04/96
No.	By	Revisions	Date

Date: February 12/99	Scale: N.T.S	Dwg. No. F-7
Drawn by: Bob Smith	Cad file: c:\...\drawings\standard\By_F7	